



COOLAUTOMATION

YOUR HVAC JUST GOT SMARTER

Quick Installation Guide

CoolMaster Product Line:

CoolMaster, CoolMasterPro, CoolMasterNet

HVAC Bridge

Warning

Read these **Safety Precautions** carefully to ensure correct installation.

This manual classifies precautions into **WARNING** and **CAUTION**.



Failure to follow WARNING is very likely to result in such grave consequences as death or serious injury

WARNING

- Only qualified personnel must carry out the installation work.
- Ask your dealer or technical representative to install the unit.
- Any deficiency caused by your own installation may result in an electric shock or fire.
- All electrical work must be performed by a licensed technician, according to local regulations and in accordance with the instructions in the installation manual.
- Any lack of electric circuit or any deficiency caused by installation may result in an electric shock or fire.
- Do not relocate or reinstall the **CoolMaster device** by yourself.
- Any deficiency caused by your own re-installation may result in an electric shock or fire.
- Make sure that all wiring is secured, that specified wires are used and that no external forces act on terminal connections or wires. Improper wiring connections or installation may produce heat and result in fire.
- Before touching electrical parts, turn off the unit.
- To dispose of this product, consult your dealer.

Caution



Failure to follow CAUTION may result in serious injury or property damage, and in certain circumstances, may result in a grave onsequence.

CAUTION

- Do not allow children to play with the **CoolMaster device** and supervise them not to get access to the appliance.
- **CoolMaster device** is not to be used by persons with reduced physical, sensory or mental capabilities, or lack of experience and knowledge.
- Do not disassemble, modify or repair the **CoolMaster device**.
- Any deficiency caused by your modification or repair may result in an electric shock or fire.
- Never let the **CoolMaster device** to get wet.
- Water can cause damage to the **CoolMaster device**, and may cause an electric shock or fire.
- Do not use flammable materials (e.g. hairspray or insecticide) near the **CoolMaster device**.
- Do not clean the **CoolMaster device** with organic solvents such as paint thinner. The use of organic solvents may cause cracking, damaging the **CoolMaster device**, causing electrical shock or fire.
- **Do not apply AC110V or AC220V to the CoolMaster device. The maximum voltage that can be applied to the unit directly is 24V DC.**
- If damaged **CoolMaster device** can generate heat and cause a fire.

Caution



Failure to follow CAUTION may result in serious injury or property damage, and in certain circumstances, may result in a grave consequence.

DO NOT INSTALL THE COOLMASTER DEVICE IN THE FOLLOWING LOCATIONS:

- a) Where a mineral oil mist or oil spray or vapor is produced, for example, in a kitchen. Plastic parts may deteriorate and fall off or result in water leakage.
- b) Where corrosive gas, such as sulfurous acid gas, is produced.
- c) Near machinery emitting electromagnetic waves. Electromagnetic waves may disturb the operation of the **CoolMaster device** and cause the unit to malfunction.
- d) Where flammable gas may leak, where there is carbon fiber or ignitable dust suspensions in the air, or where volatile flammable such as thinner or gasoline are handle Operating the **CoolMaster device** in such conditions can cause a fire.
- e) High temperature area or directly flamed point. Heating and/or fire can occur.
- f) Moist area, where there is exposure to water. If water enters the inside of the **CoolMaster device**, it may cause electric shock and electrical components may fail.

Contents

Warning	2
Caution.....	3
Contents	5
What's in the box	6
CoolMaster Device.....	7
Preconfigured CoolMaster Device	8
HVAC Line configuration	9
CoolMaster Prodcut line	10

L7 HVAC Gree/GMV4 VRF (Lennox, Tica, Innovair).....	22
HVAC Midea VRF (Intensity, Trane, Carrier, Lennox, Comfort Star, Kentatsu, Electra ,Voltas, Bryant, Maxxa, Ecox, Clivet, Bosch ,SystemAir, Lessar, NED, Dantex, Sanys)	23
HVAC Samsung VRF (Trane)	24
HVAC Chigo VRF (Rheem, Sharp)	25
HVAC Blue Star VRF.....	26
HVAC TICA VRF	27


L1 HVAC Daikin VRV (Yanmar).....	11
HVAC Daikin Non-VRV	12
HVAC Mitsubishi Electric VRF (Trane)	13
HVAC Mitsubishi Electric Non-VRF	14
HVAC Panasonic/Sanyo VRF.....	15
HVAC Toshiba VRF (Carrier)	16
HVAC Hitachi VRF (Hisense, York, JCI)	17
HVAC Haier VRF (York, Trane, CIAC)	18

L8 HVAC Gree GMV5, GMV6 (Gree) VRF (Fujitherma, Aermec, Tosot, Tadiran, Energolux, AlpicAir, Cooper&Hunter, Pioneer, Lennox, Air Con)	28
HVAC Fujitsu VRF (Rheem, Atlantic)	29


L7 HVAC Mitsubishi Heavy VRF.....	19
HVAC LG VRF (Arcelik)	20
HVAC AUX VRF (Rheem, IGC).....	21

How to change the brand of a specific line	30
CoolMaster Device installation complete	31
Home Automation, BMS & iocControl App.....	32
Power Supply.....	33
All On/Off operation by external signal	34
Mounting on DIN rail.....	35
Mounting on a wall	36
Online documentation and Support	37


What's in the box

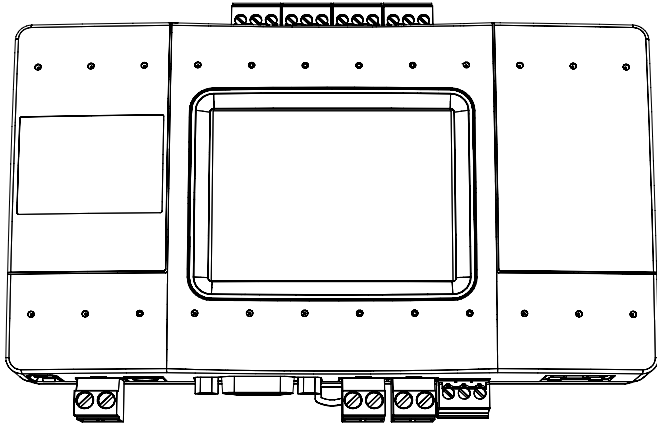


CoolMaster device

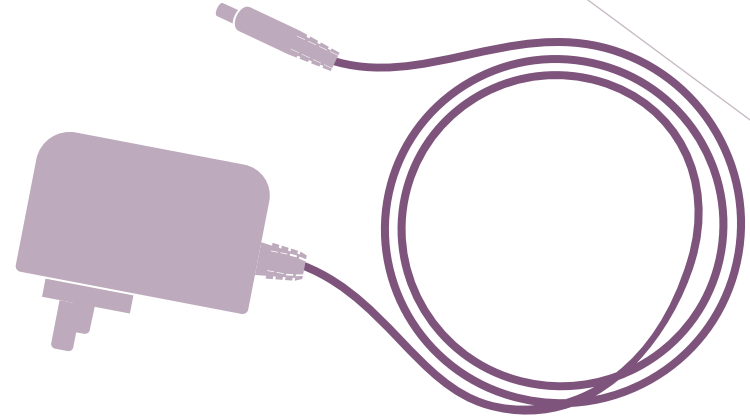


AC Power supply adapter
100V-240V 50/60hz to 12V

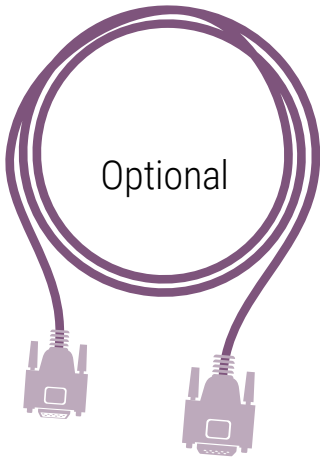

Optional
1 RS232 DB9
Male to Female
cable

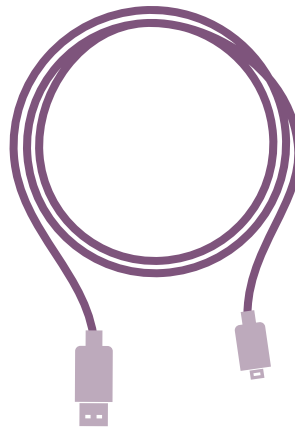


1 USB-Mini USB
cable

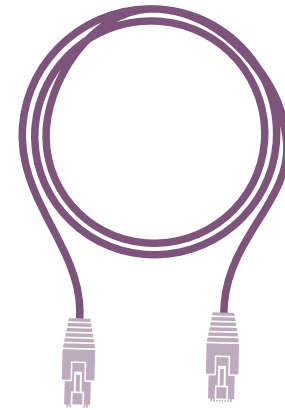

1 Ethernet
cable

CoolMaster device

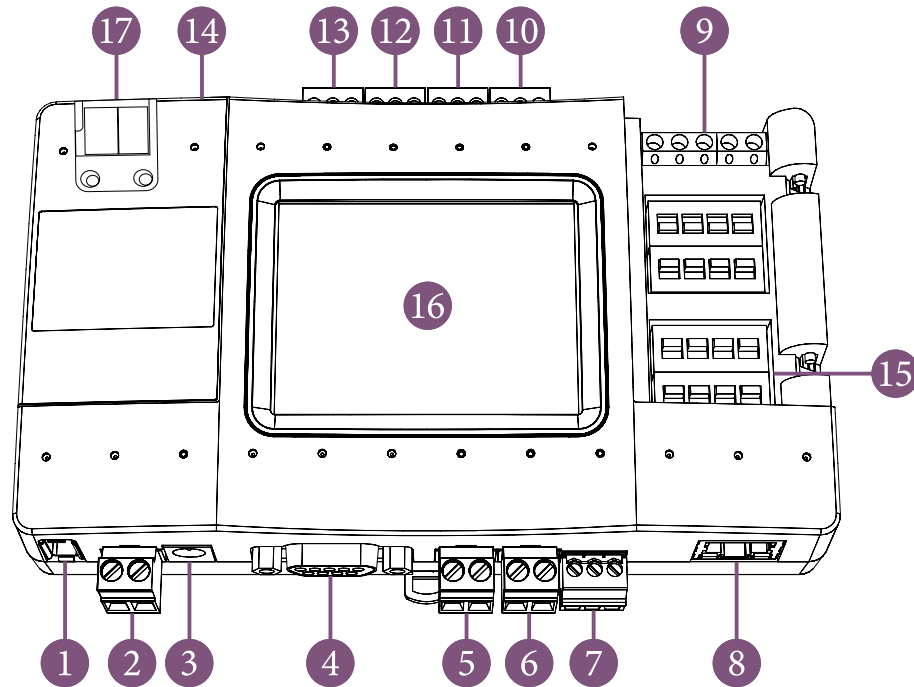

1 L8 - HVAC Line 8 (USB Host)

2 Power

3 Power Plug

4 RS232 Port

5 L1 - HVAC Line 1

6 L2 - HVAC Line 2

7 L3 - RS485

8 Ethernet Port

9 GPIOs

10 L7 - HVAC Line 7

11 L6 - HVAC Line 6

12 L5 - HVAC Line 5

13 L4 - HVAC Line 4

14 USB Device Port

15 DIP Switches P, Q, R, S


16 LCD Touch Screen

17 KNX (option)

Preconfigured CoolMaster Device


Type label

This label uniquely identifies the manufacturer's configuration of the CoolMaster device. Located on the back of the enclosure.

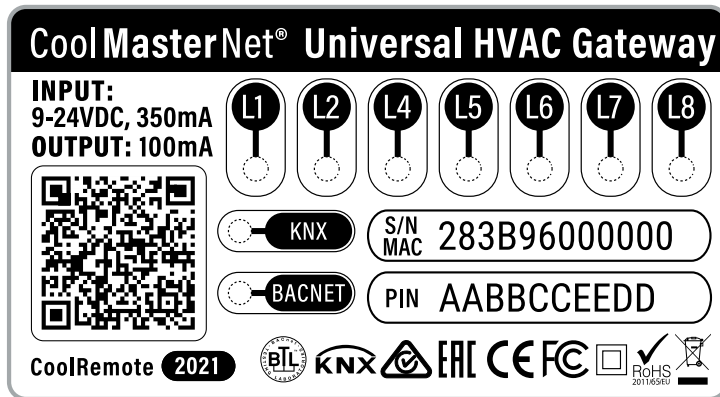

Type label with Configuration sticker

A preconfigured label example:
configured for LG on L7

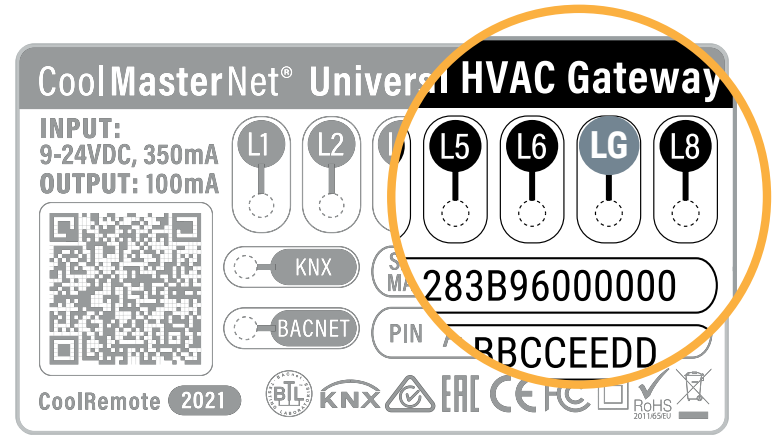

HVAC Line configuration

- DK Daikin
- HT Hitachi
- HA Haier
- ME Mitsubishi Electric
- TO Toshiba
- PN Panasonic
- FJ Fujitsu
- LG LG
- SM Samsung
- MD Midea
- CG Chigo
- GR Gree
- AU AUX
- BS Blue Star
- MH Mitsubishi Heavy

CoolMaster Product line



	COOLMASTER	COOLMASTERPRO
Market Segment	Residential	Medium and Large Commercial
Main Use	Home Automation Integration, Remote control App	BMS integration
Max Connected Units	32	256*
Local access to service data	X	✓

* Max Connected Units is different per VRF/VRV manufacturer and include any type of connected unit (VRF indoor, CP, sensor, fan coil, any other HVAC unit). Please refer to technical specifications for more details.

HVAC Daikin VRV

1 HVAC Communication Terminals

HVAC outdoor connection



- * For Heat Recovery systems the connection is at outdoor units only.
- * See table on page 10 for Max connected indoors per model.
- * Polarity is not required on the HVAC communication line.
- ** Centralized (group) address required.

2 Connecting to the line plug




Secure the cables in the L1 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L1 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRV HVAC system on L1.

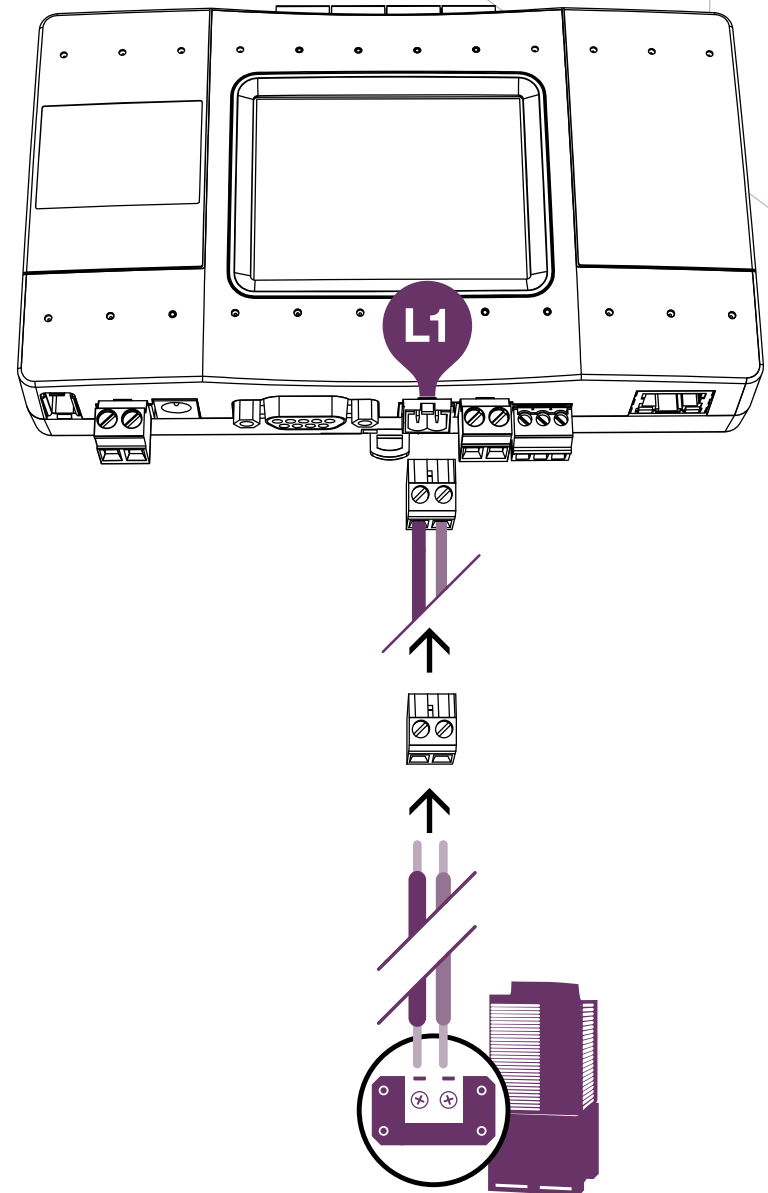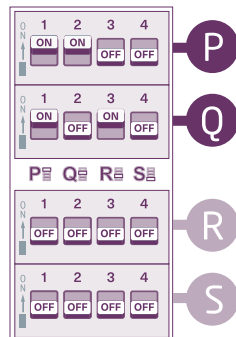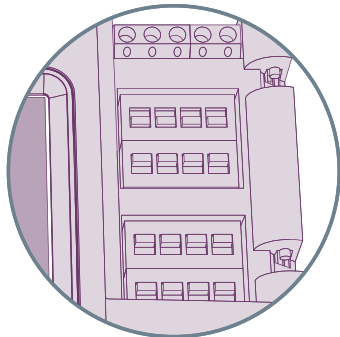

Daikin HVAC Terminal

HVAC Daikin Non-VRV



Changing the dip switches **S**, while DC voltage is present on L1, may damage the CoolMaster device.

For Daikin Non-VRV equipment. DC voltage supply by CoolMaster device might be required for proper operation.

! Make sure CoolMaster device is disconnected from power and HVAC line.

1 HVAC Communication Terminals

HVAC outdoor connection






* See table on page 10 for Max connected indoors per model.

* Polarity is not required on the HVAC communication line.

** Centralized (group) address required.

- 2 Measure DC voltage on HVAC comm. line L1.
- 3 If no **14-16V DC voltage** change the dip switches as shown below:
Go to settings → Go to HVAC lines → Go to L1 → Go to DC Out turn on
- 4 Turn on the power for CoolMaster device and connect it to HVAC line.
- 5 Connect to the communication terminals on the HVAC equipment and secure the cables in the L1 line plug.
- 6 Insert the plug in to CoolMaster device L1 socket.

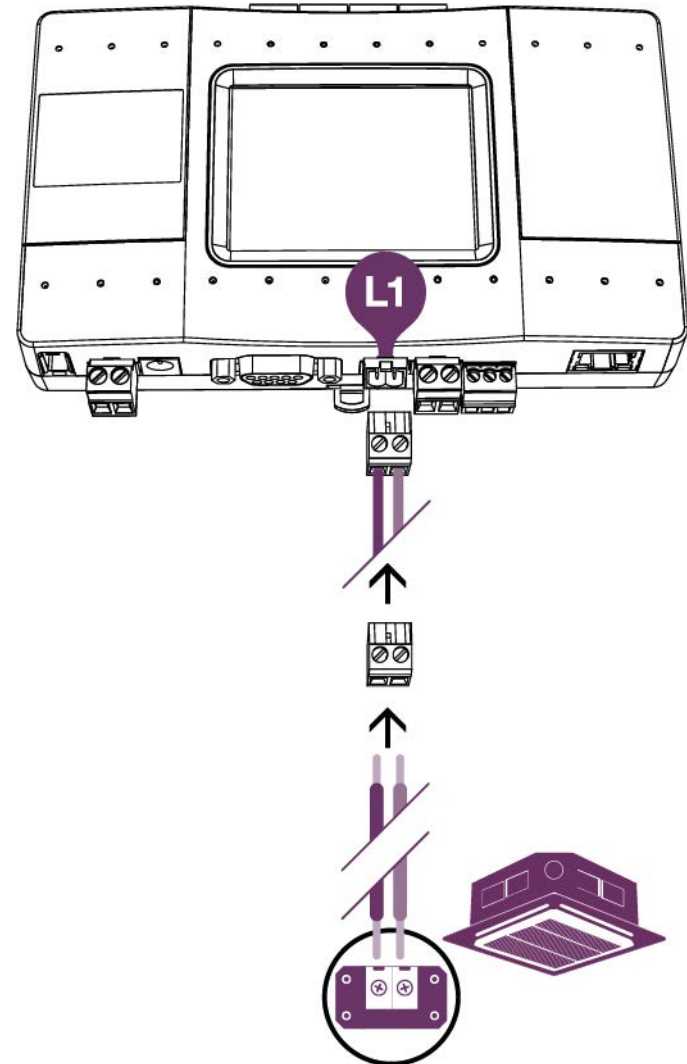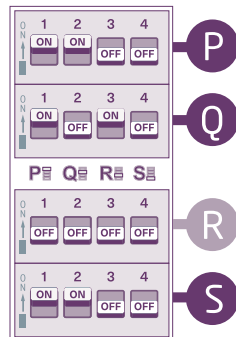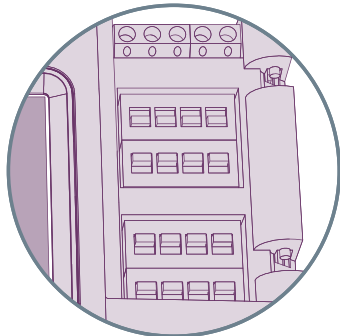


Daikin Non-VRV HVAC Terminal

HVAC Mitsubishi Electric VRF

1 HVAC Communication Terminals

HVAC outdoor connection



- * See table on page 10 for Max connected indoors per model.
- * For Heat Recovery systems the connection is at outdoor units only.
- * Polarity is not required on the HVAC communication line.

2 Connecting to the line plug




Secure the cables in the L1 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L1 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L1.

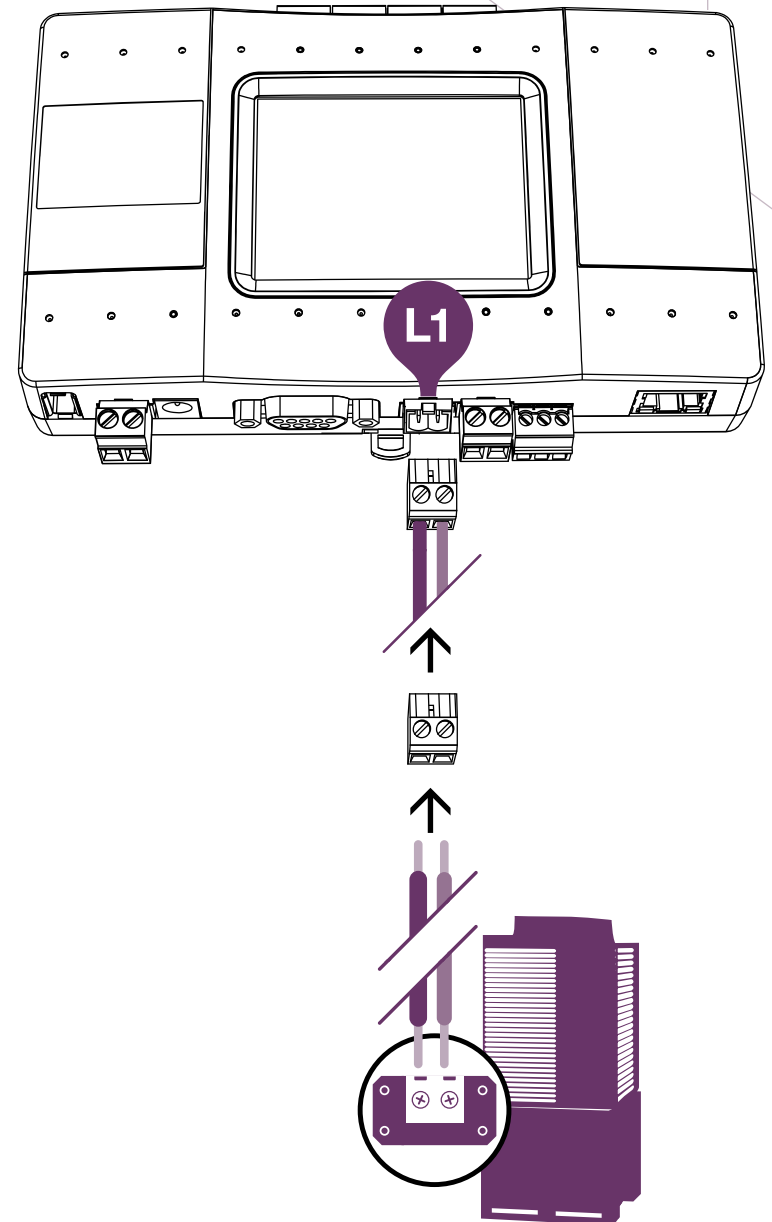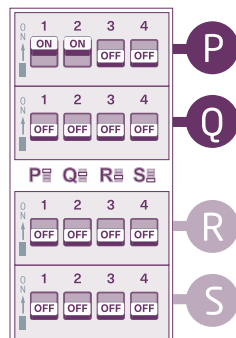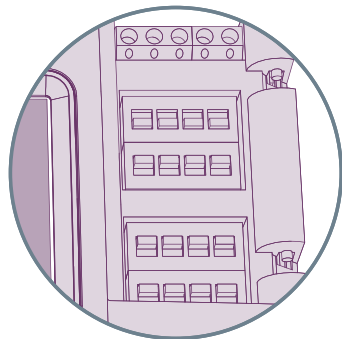

Mitsubishi Electric HVAC Terminal

HVAC Mitsubishi Electric Non-VRF




Changing the dip switches **S**, while DC voltage is present on L1, may damage the CoolMaster device.

For Mitsubishi Electric Non-VRF equipment. DC voltage supply by CoolMaster device might be required for proper operation.

⚠ Make sure CoolMaster device is disconnected from power and HVAC line.




1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.
* Polarity is not required on the HVAC communication line.

- 2 Measure DC voltage on HVAC comm. line L1.
- 3 If no **28-30V DC voltage** change the dip switches as shown below:
Go to settings → Go to HVAC lines → Go to L1 → Go to DC Out turn on
- 4 Turn on the power for CoolMaster device and connect it to HVAC line.
- 5 Connect to the communication terminals on the HVAC equipment and secure the cables in the L1 line plug.
- 6 Insert the plug in to CoolMaster device L1 socket.

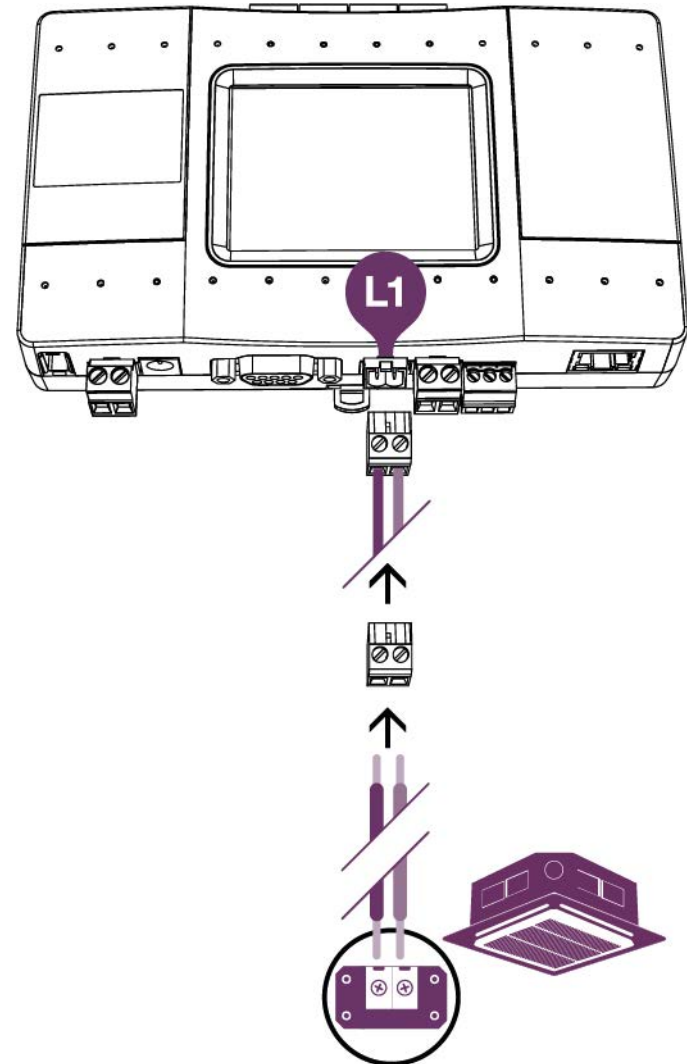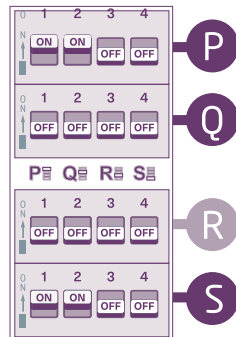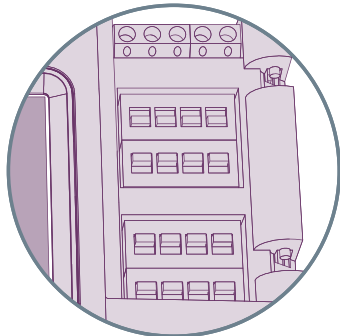


Mitsubishi Electric Non-VRF HVAC Terminal

HVAC Panasonic/Sanyo VRF

1 HVAC Communication Terminals

HVAC outdoor connection



- * See table on page 10 for Max connected indoors per model.
- * For Heat Recovery systems the connection is at outdoor units only.
- * Polarity is not required on the HVAC communication line.

2 Connecting to the line plug




Secure the cables in the L1 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L1 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L1.

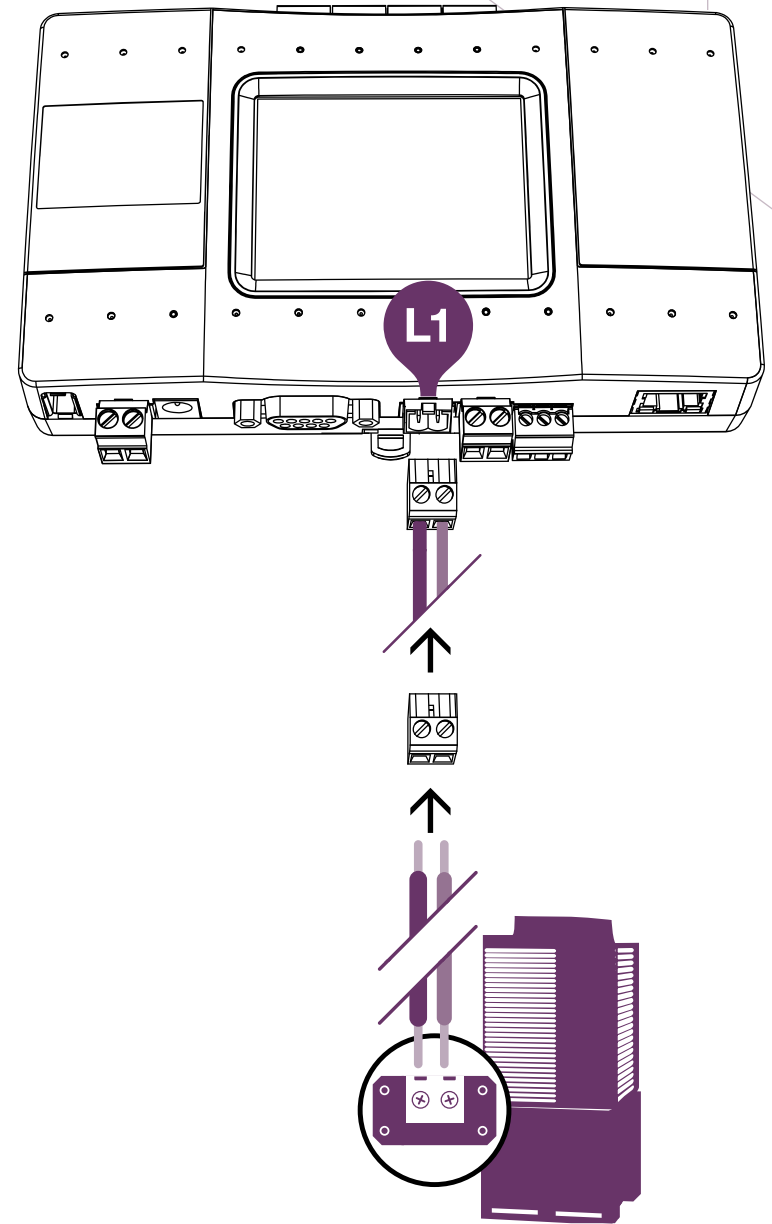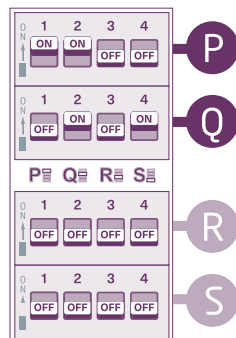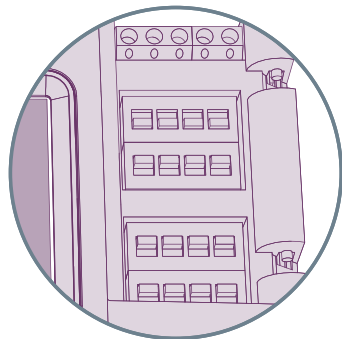


Panasonic / Sanyo HVAC Terminal

HVAC Toshiba VRF

1 HVAC Communication Terminals

HVAC outdoor connection



- * See table on page 10 for Max connected indoors per model.
- * For Heat Recovery systems the connection is at outdoor units only.
- * Polarity is not required on the HVAC communication line.

2 Connecting to the line plug




Secure the cables in the L1 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L1 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L1.

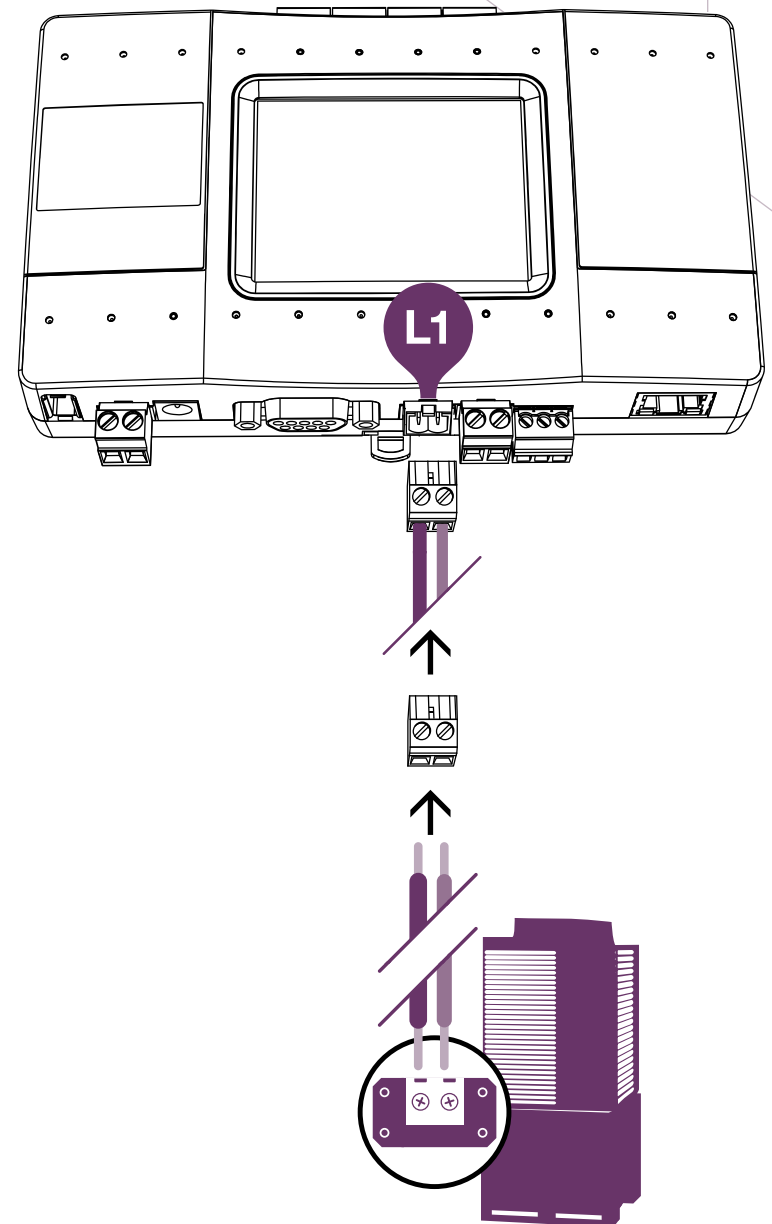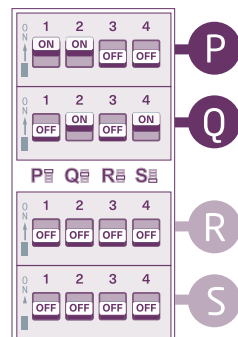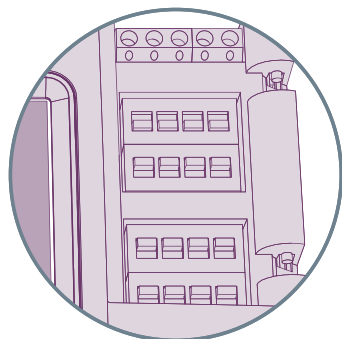

Toshiba HVAC Terminal

HVAC Hitachi VRF

1 HVAC Communication Terminals

HVAC outdoor connection



- * See table on page 10 for Max connected indoors per model.
- * For Heat Recovery systems the connection is at outdoor units only.
- * Polarity is not required on the HVAC communication line.

2 Connecting to the line plug




Secure the cables in the L1 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L1 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L1.

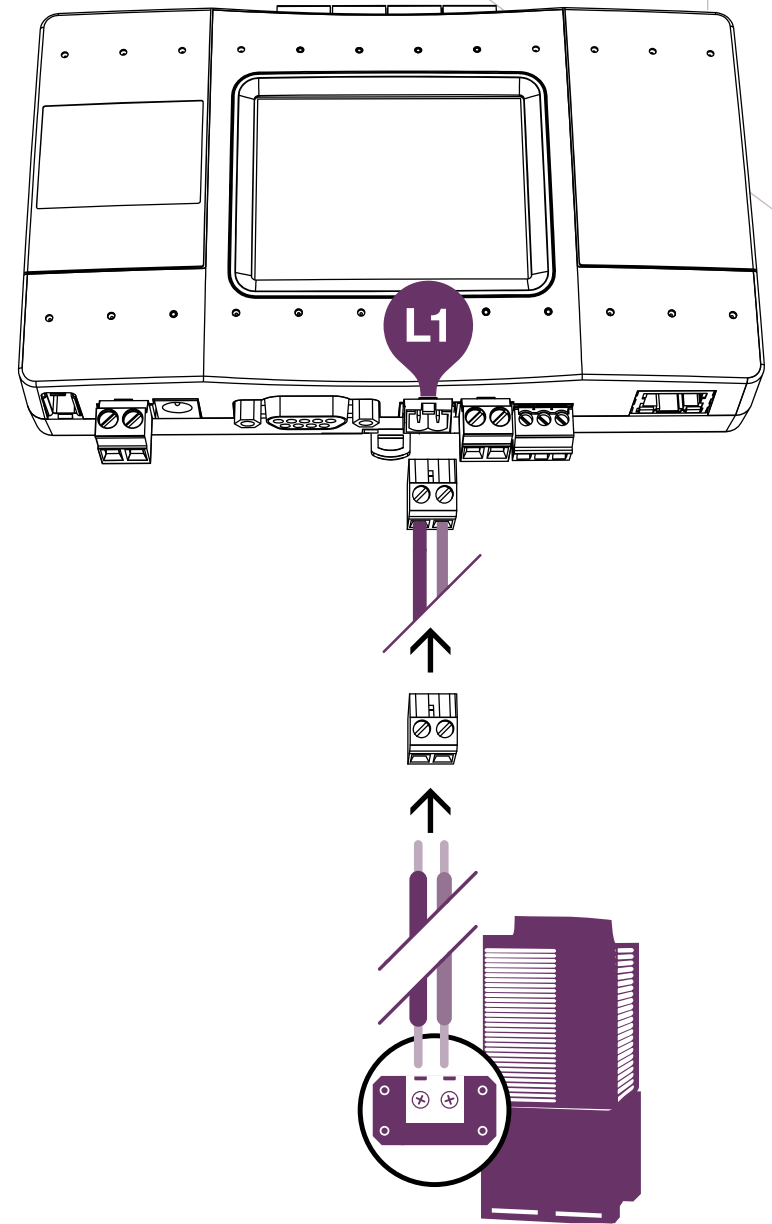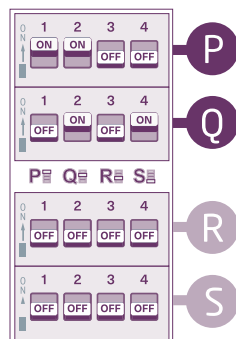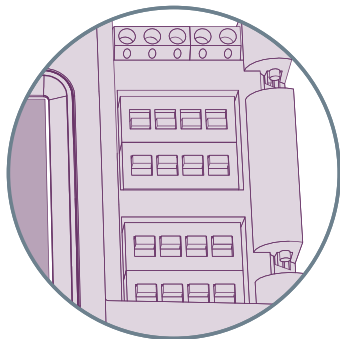


Hitachi HVAC Terminal

HVAC Haier VRF

1 HVAC Communication Terminals

HVAC outdoor connection



- * See table on page 10 for Max connected indoors per model.
- * For Heat Recovery systems the connection is at outdoor units only.
- * Polarity is not required on the HVAC communication line.

2 Connecting to the line plug





Secure the cables in the L1 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L1 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L1.

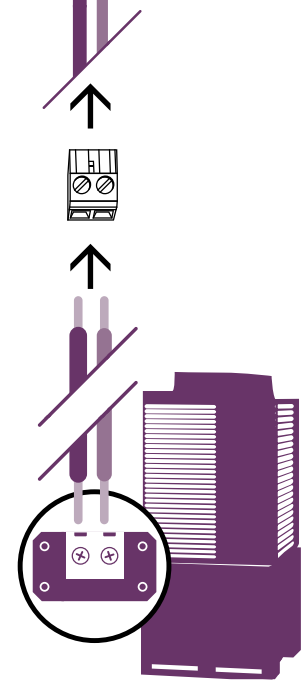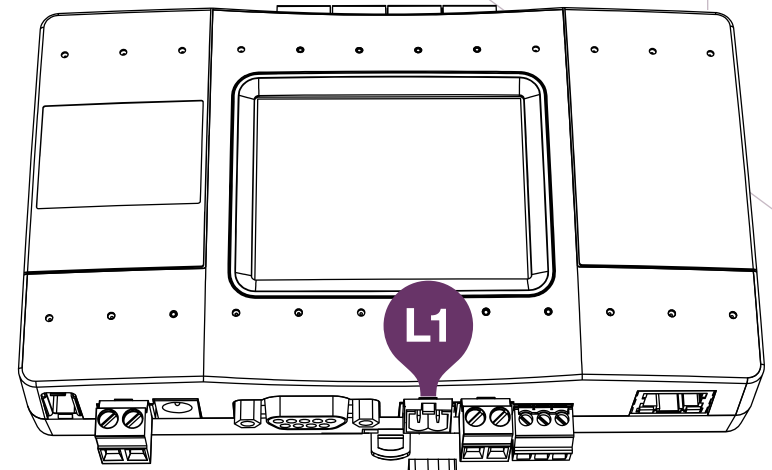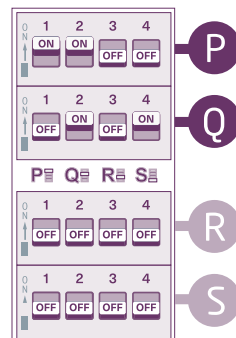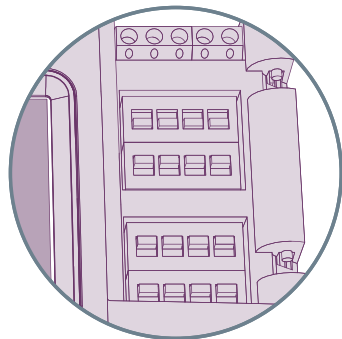


Haier HVAC Terminal

HVAC Mitsubishi Heavy VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device


Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

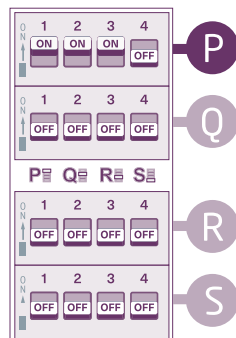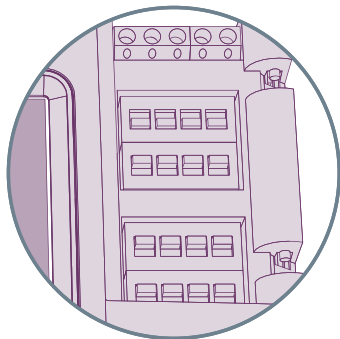


Mitsubishi Heavy HVAC Terminal

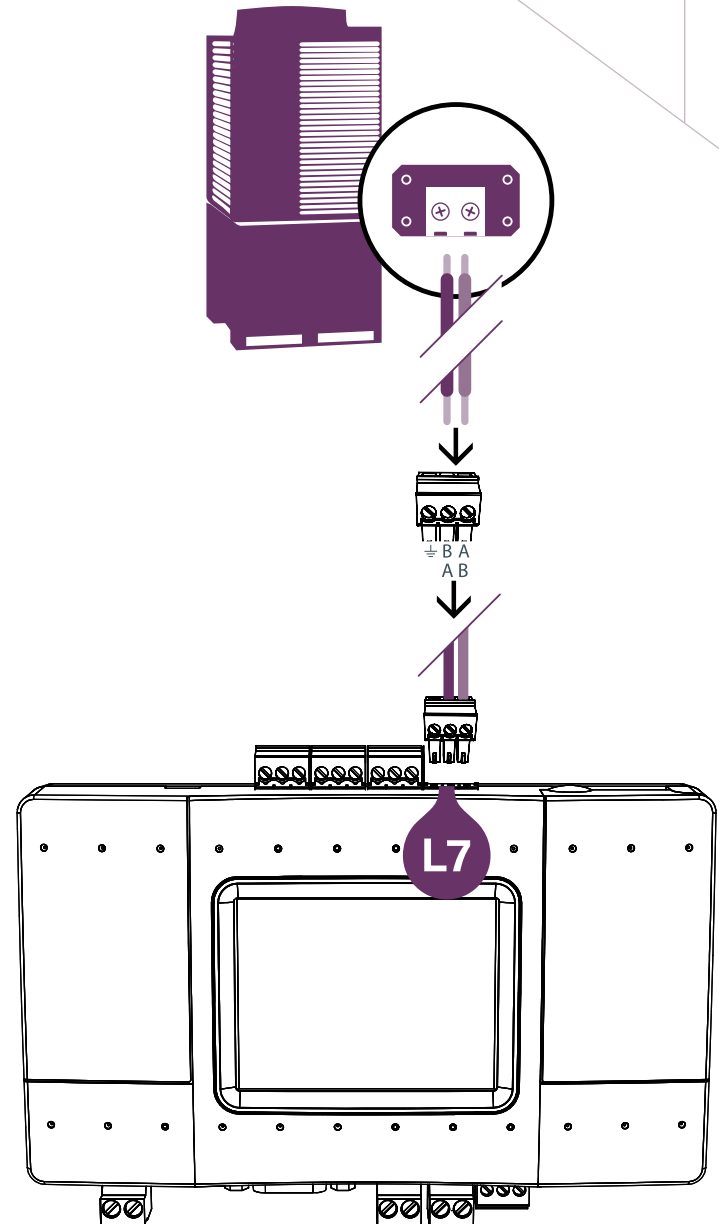

HVAC LG VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device



Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

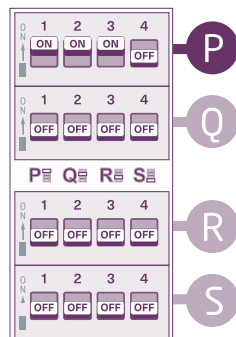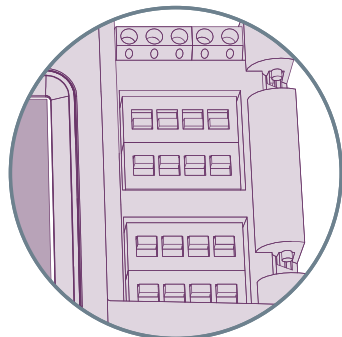

LG HVAC Terminal

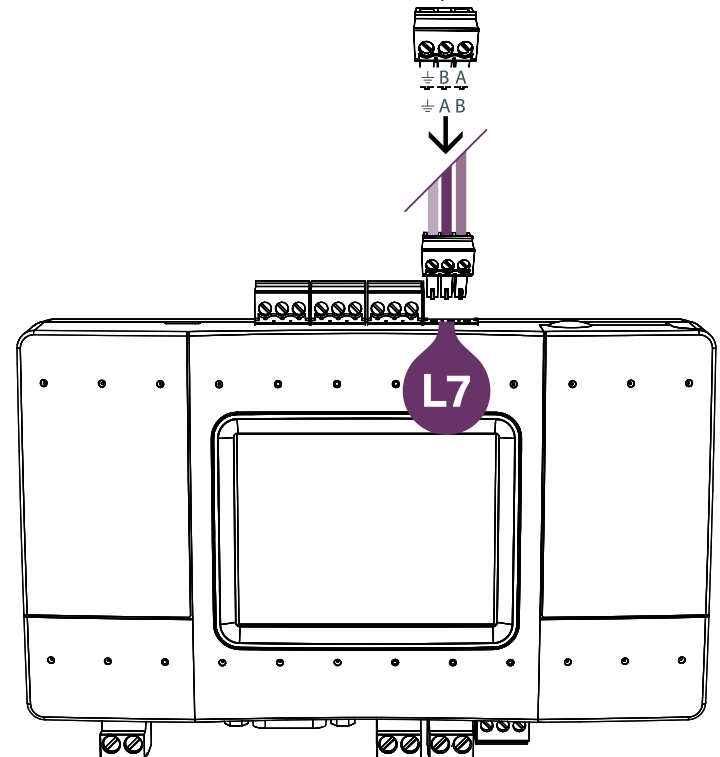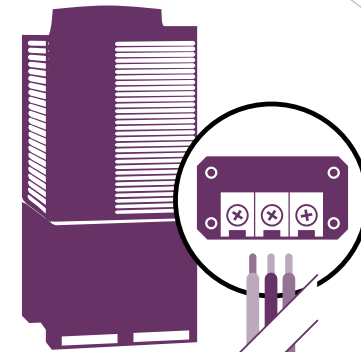

HVAC AUX VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device


Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

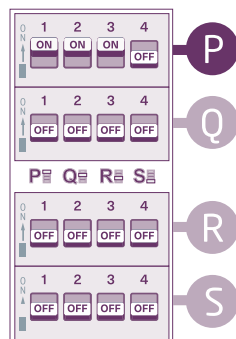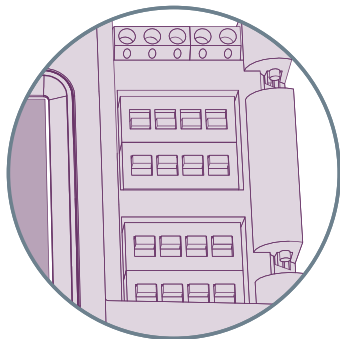


AUX HVAC Terminal

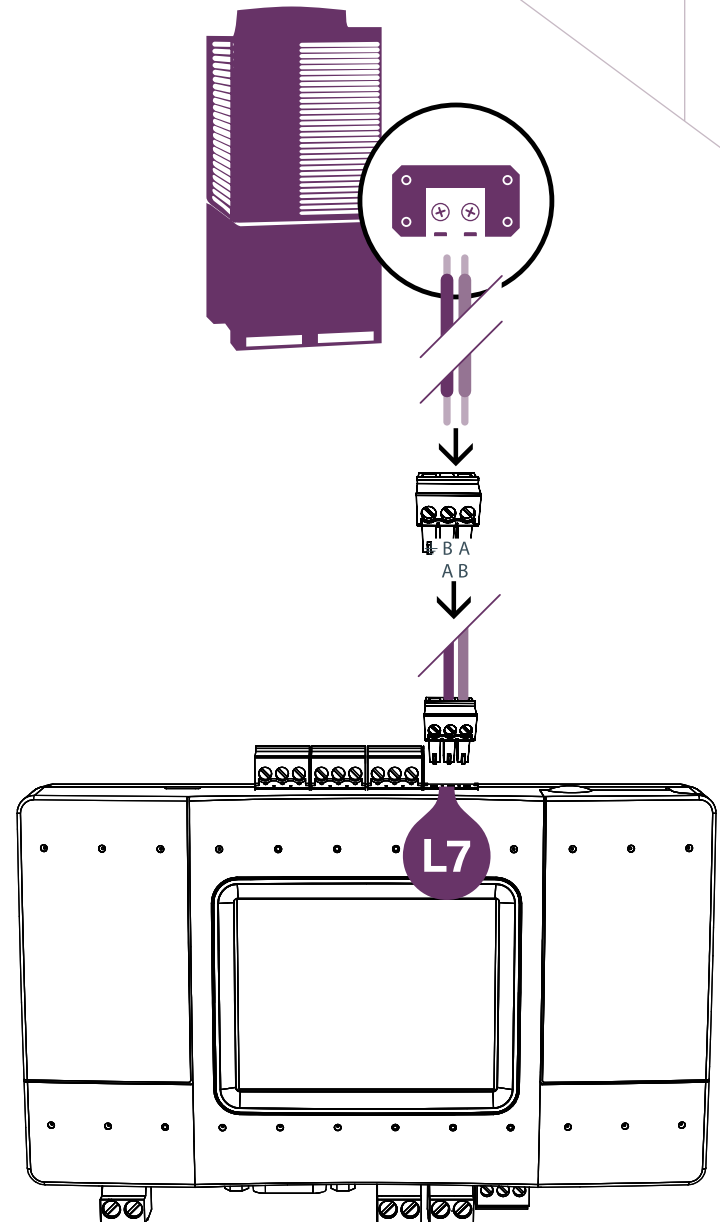

HVAC Gree/GMV4 VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug




Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

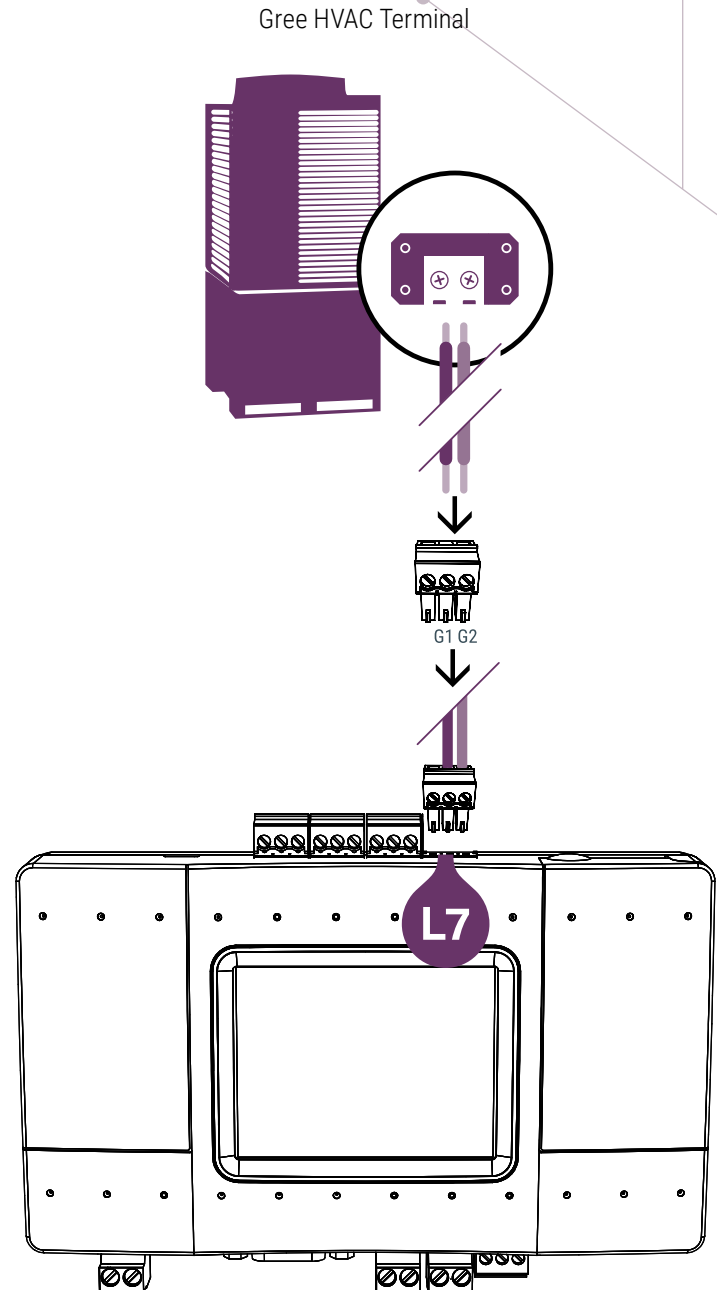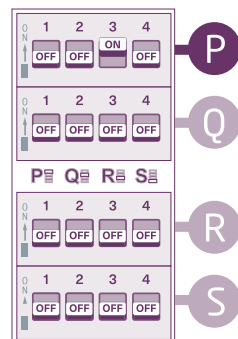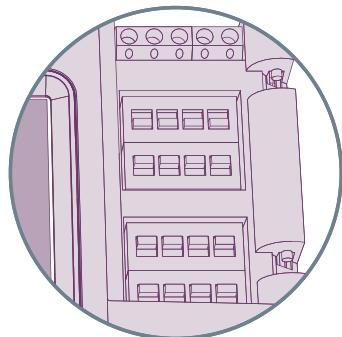

HVAC Midea VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device


Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

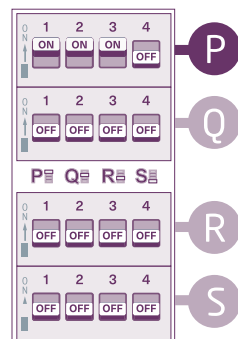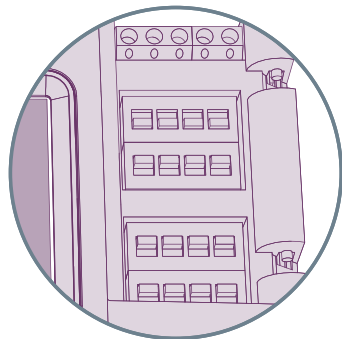

Midea HVAC Terminal

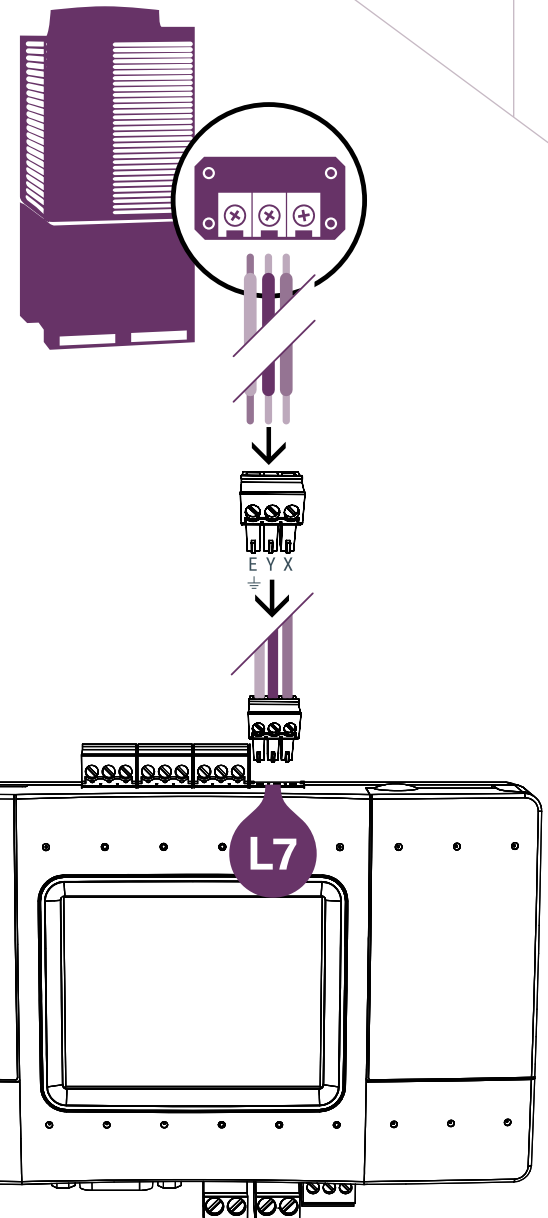

HVAC Samsung VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device


Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

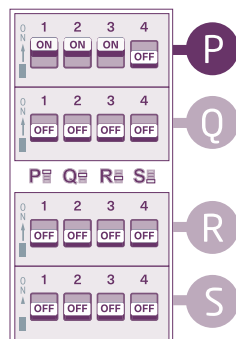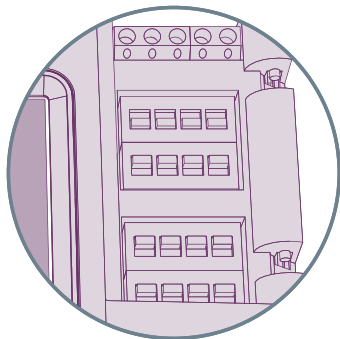

Samsung HVAC Terminal

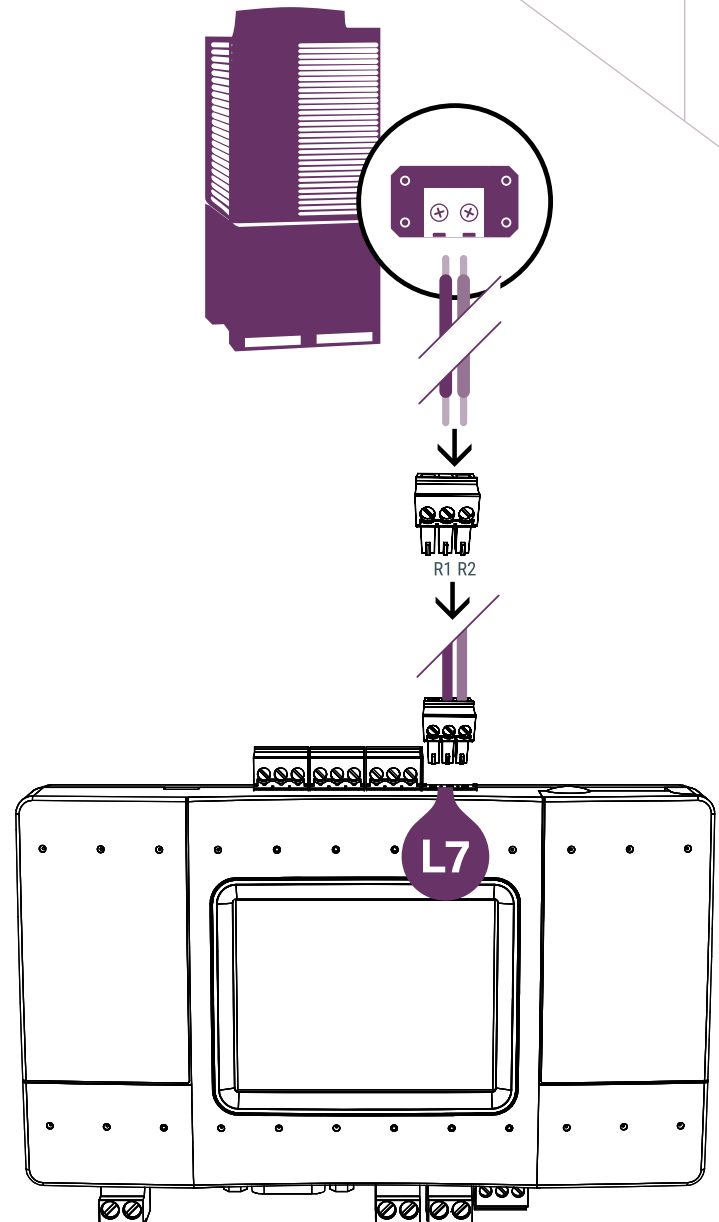

HVAC Chigo VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device


Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

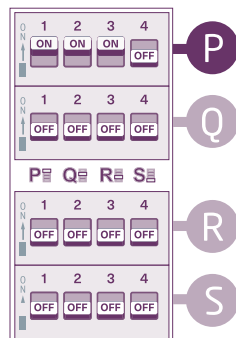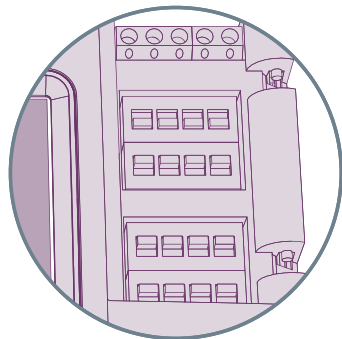

Chigo HVAC Terminal

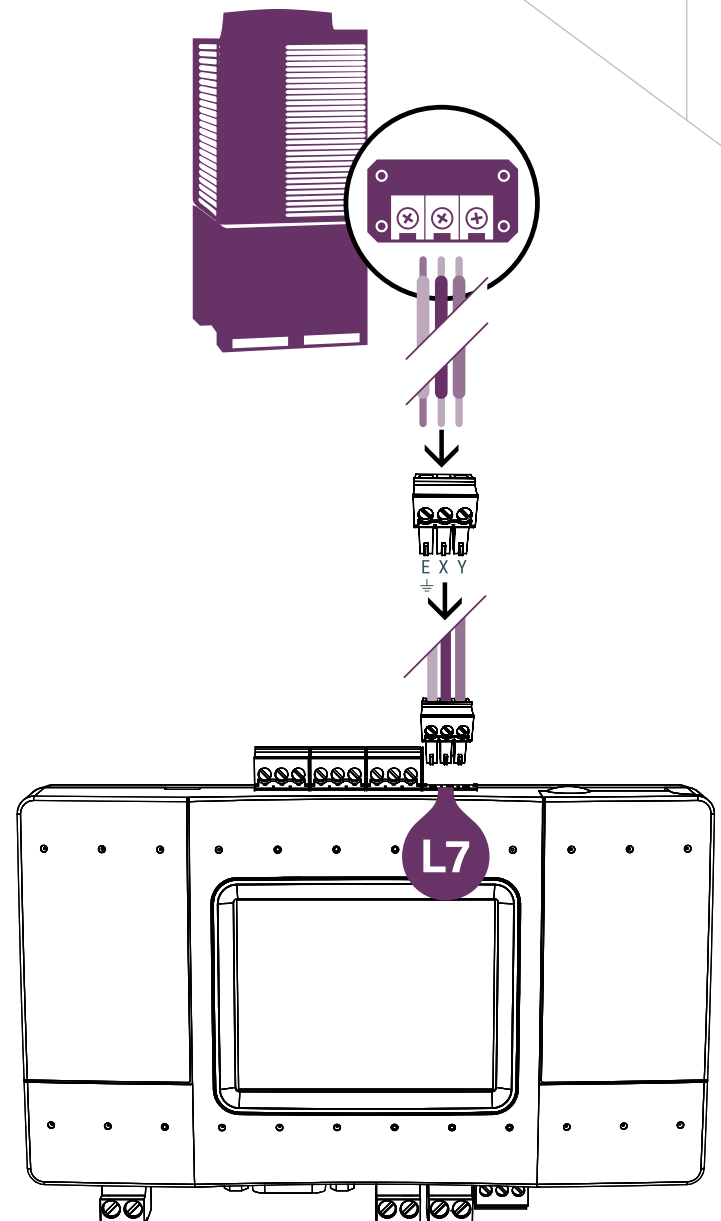

HVAC Blue Star VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the line plug



Secure the cables in the L7 line plug.

3 Plugging to the CoolMaster device


Insert the plug in to the CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

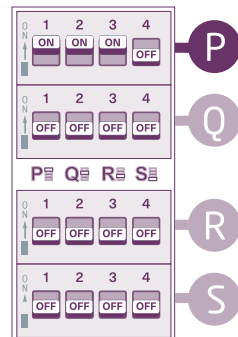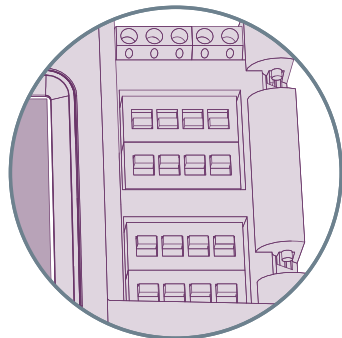

Blue Star HVAC Terminal

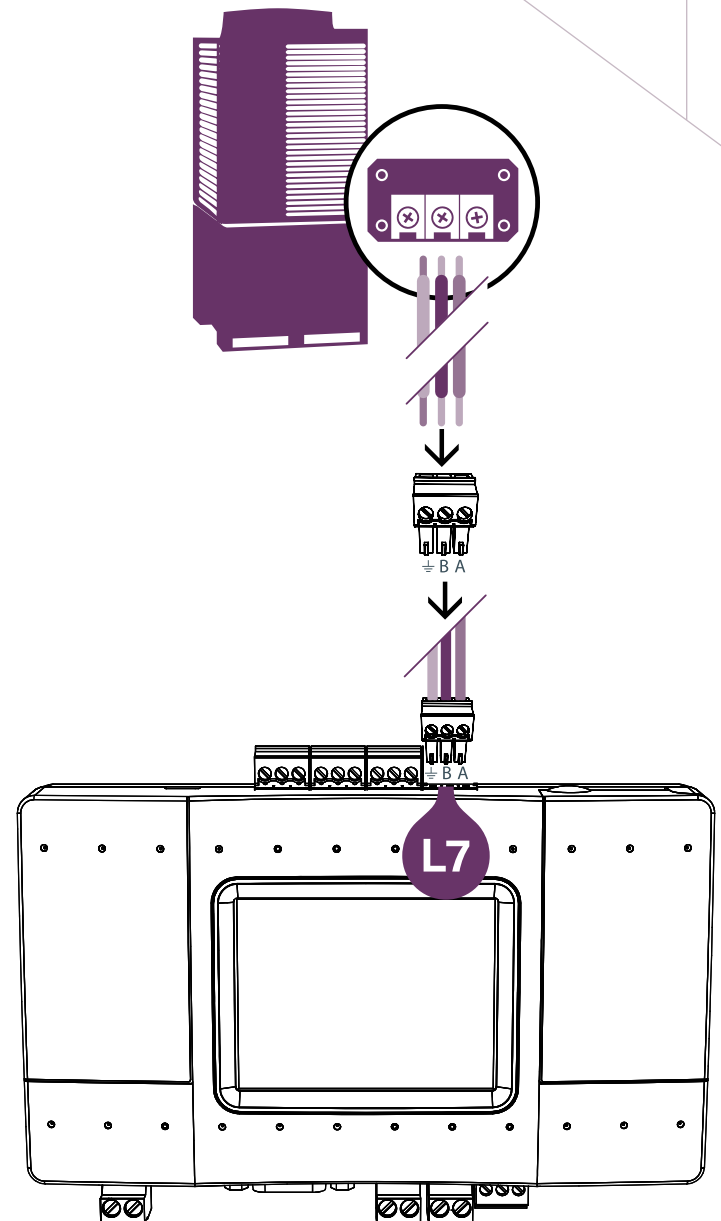

HVAC TICA VRF

1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connect Outdoor Unit



Secure wire in the A2 & B2 terminals on the Outdoor Unit.

3 Connect to CoolMaster device


Secure wire from Outdoor unit to the wire plug.
Insert wire plug to CoolMaster device L7 socket.

4 Check DIP Switches are set correctly

Dip switches setup for VRF HVAC system on L7.

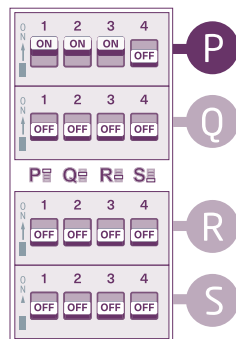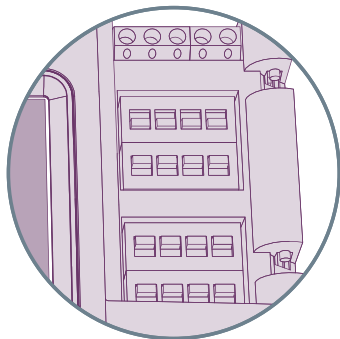


TICA Outdoor Terminals

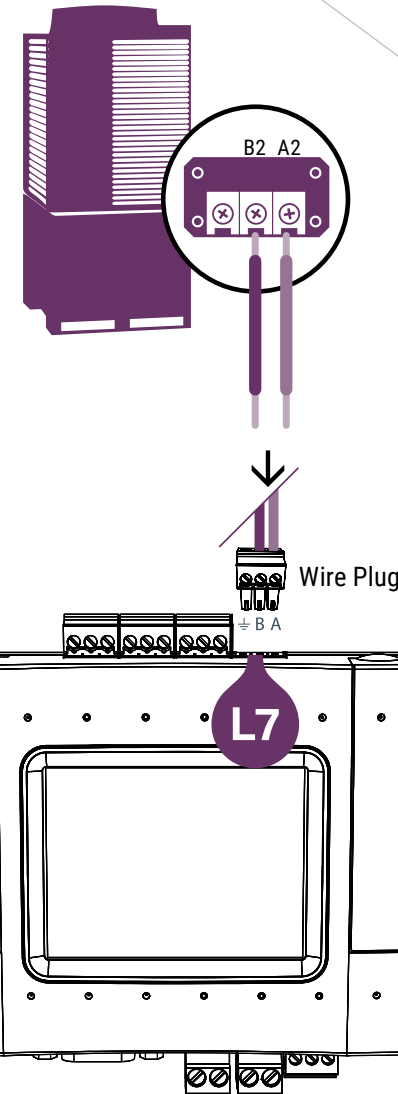


HVAC Gree GMV5, GMV6 VRF

① HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.



② Connecting to the CMNET-GR-GMV5/6

CoolAutomation USB Network Interface (CMNET-GR-GMV5/6) adapter is required for connecting up to two Gree GMV5/6 VRF lines. (Supplied by CoolAutomation)




This adapter includes a CAN bus 120 Ω resistor.

③ Plugging to the CoolMaster device

Insert the plug in to the CoolMaster device L8 (USB).

④ Check DIP Switches are set correctly

Dip switches setup for GMV5/6 VRF HVAC system on L8.

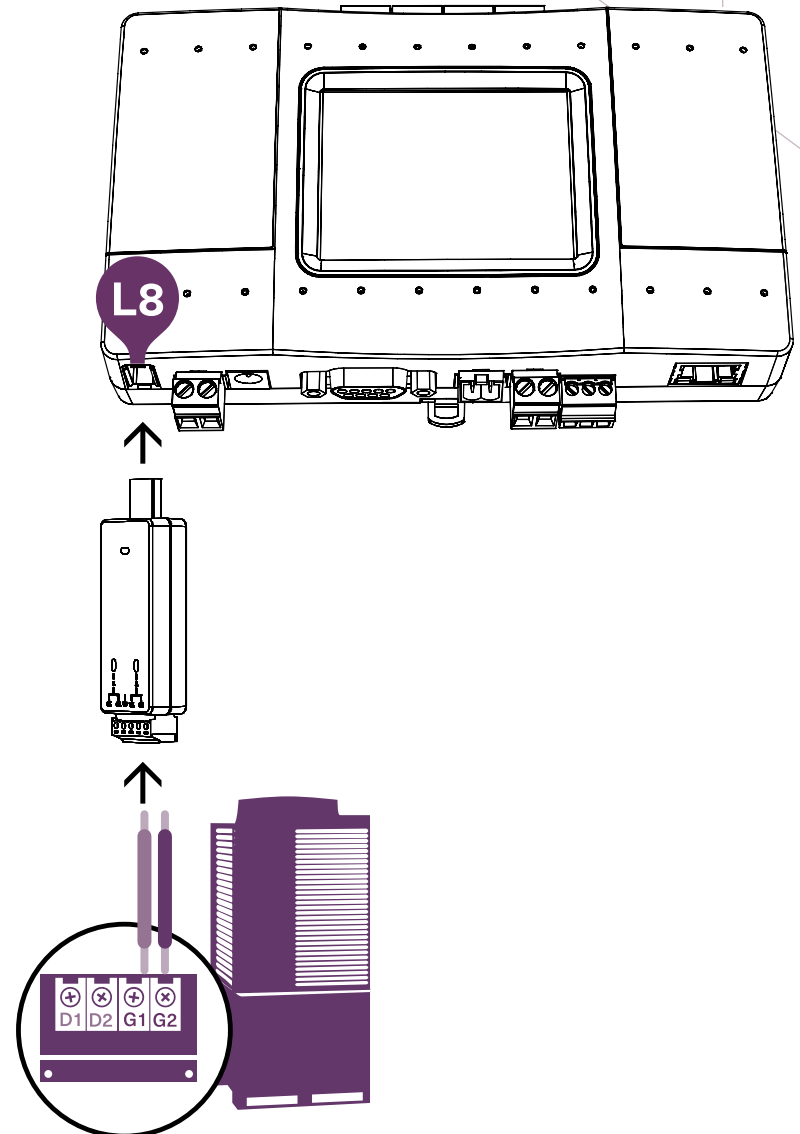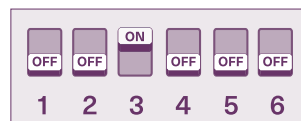

Gree GMV5/6 HVAC Terminal

HVAC Fujitsu VRF


1 HVAC Communication Terminals

HVAC outdoor connection



* See table on page 10 for Max connected indoors per model.

2 Connecting to the Echelon adapter

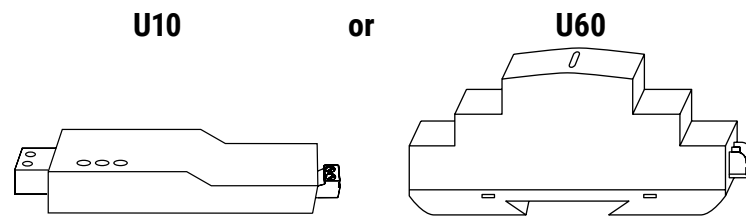


Echelon U10 USB Network Interface (TP/FT-10) adapter or U60 USB to LON FT Network Interface (model 75060R-40) adapter, is required for connecting to Fujitsu VRF. (Not supplied by CoolAutomation).

3 Connect Echelon via USB Extension cable

Connect the USB Extension cable (A-Male to A-Female) to the Echelon adapter. (Not supplied by CoolAutomation)

4 Plug in to the CoolMaster device L8


Insert the USB cable in to the L8 USB host.

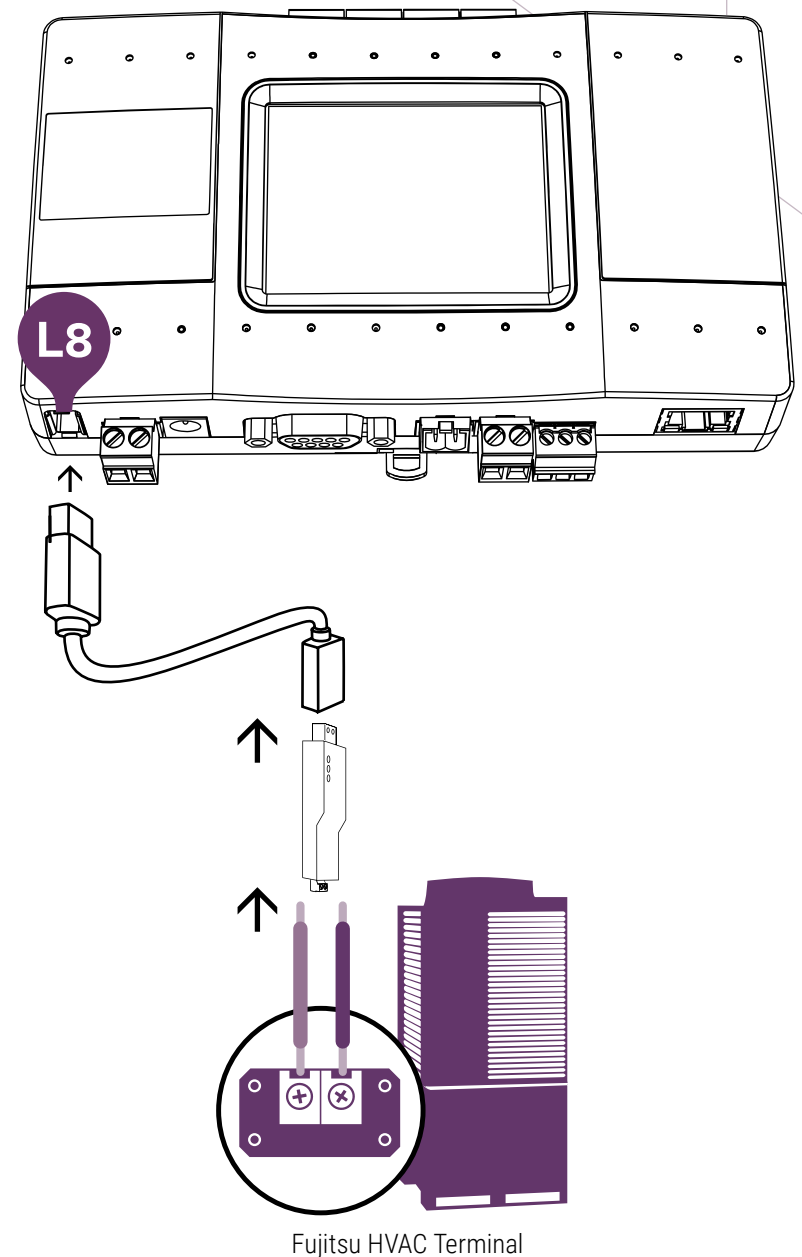


How to change the brand of a specific line

In order to change the HVAC brand type on a specific line, please follow the below procedure on CoolMaster device screen:


1 Go to Settings

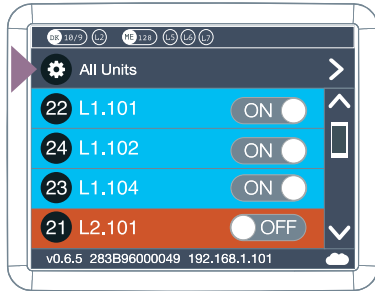



2 Go to HVAC Line

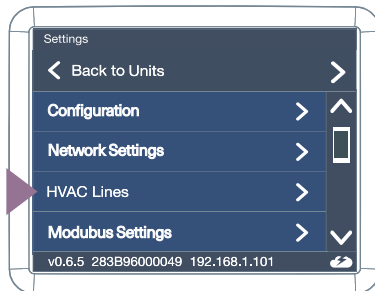

3 Select the HVAC Line you want to configure

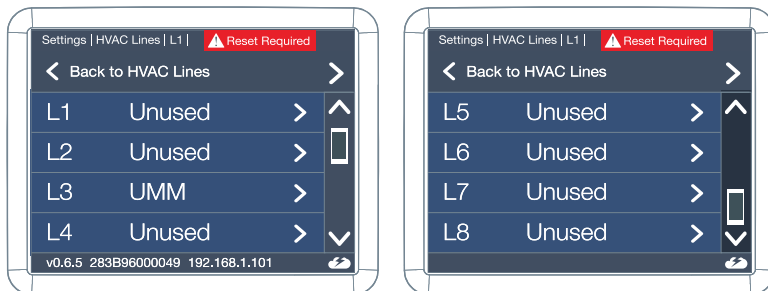

4 Configure the HVAC line type

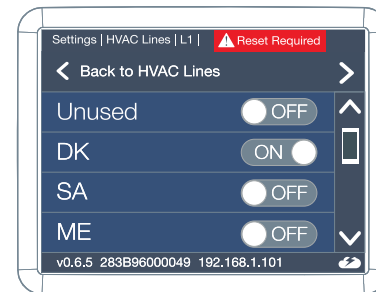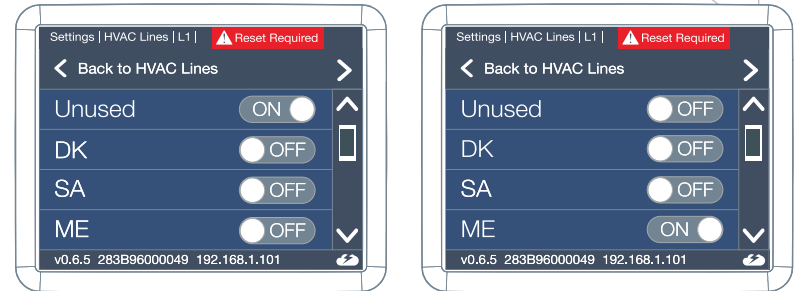

5 Make sure the DIP switches are set properly for the brand (according to the details in the brand relevant section above)

6 You will also have a red warning message if DIP switch are set incorrect


7 Reset is required to make the change


CoolMaster device installation complete

CoolMaster device Unit screen


After successful installation, unit's screen will show all the detected indoor units and their statuses.

- 1 Active HVAC line (DK 9/10) (Groups/Units)
- 2 Inactive HVAC line
- 3 All ON/OFF operation button
- 4 Scrollbar
- 5 Connected indoor unit with it's address and Set-Point temperature indication.
- 6 Indoor unit operation button (on/off)
- 7 Service settings button
- 8 CoolMaster device MAC address
- 9 CoolMaster device IP address
- 10 CoolRemote connectivity status

-  Connected - Communicating
-  Connected - Idle
-  Disconnected - with error code

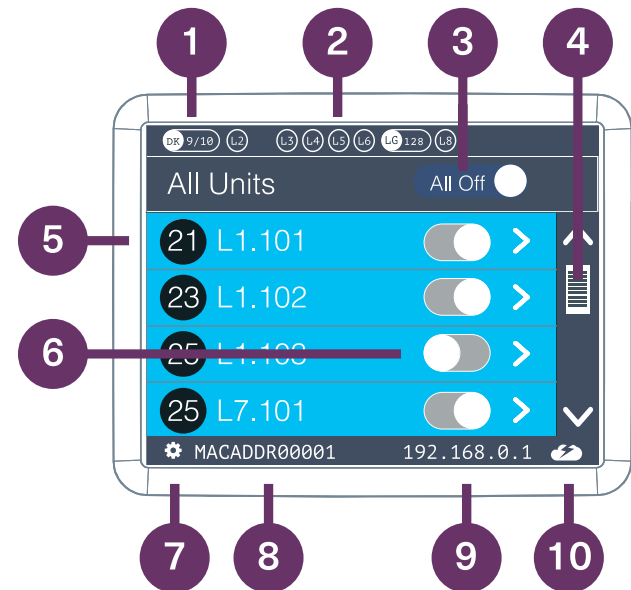


Home Automation, BMS & iocControl App

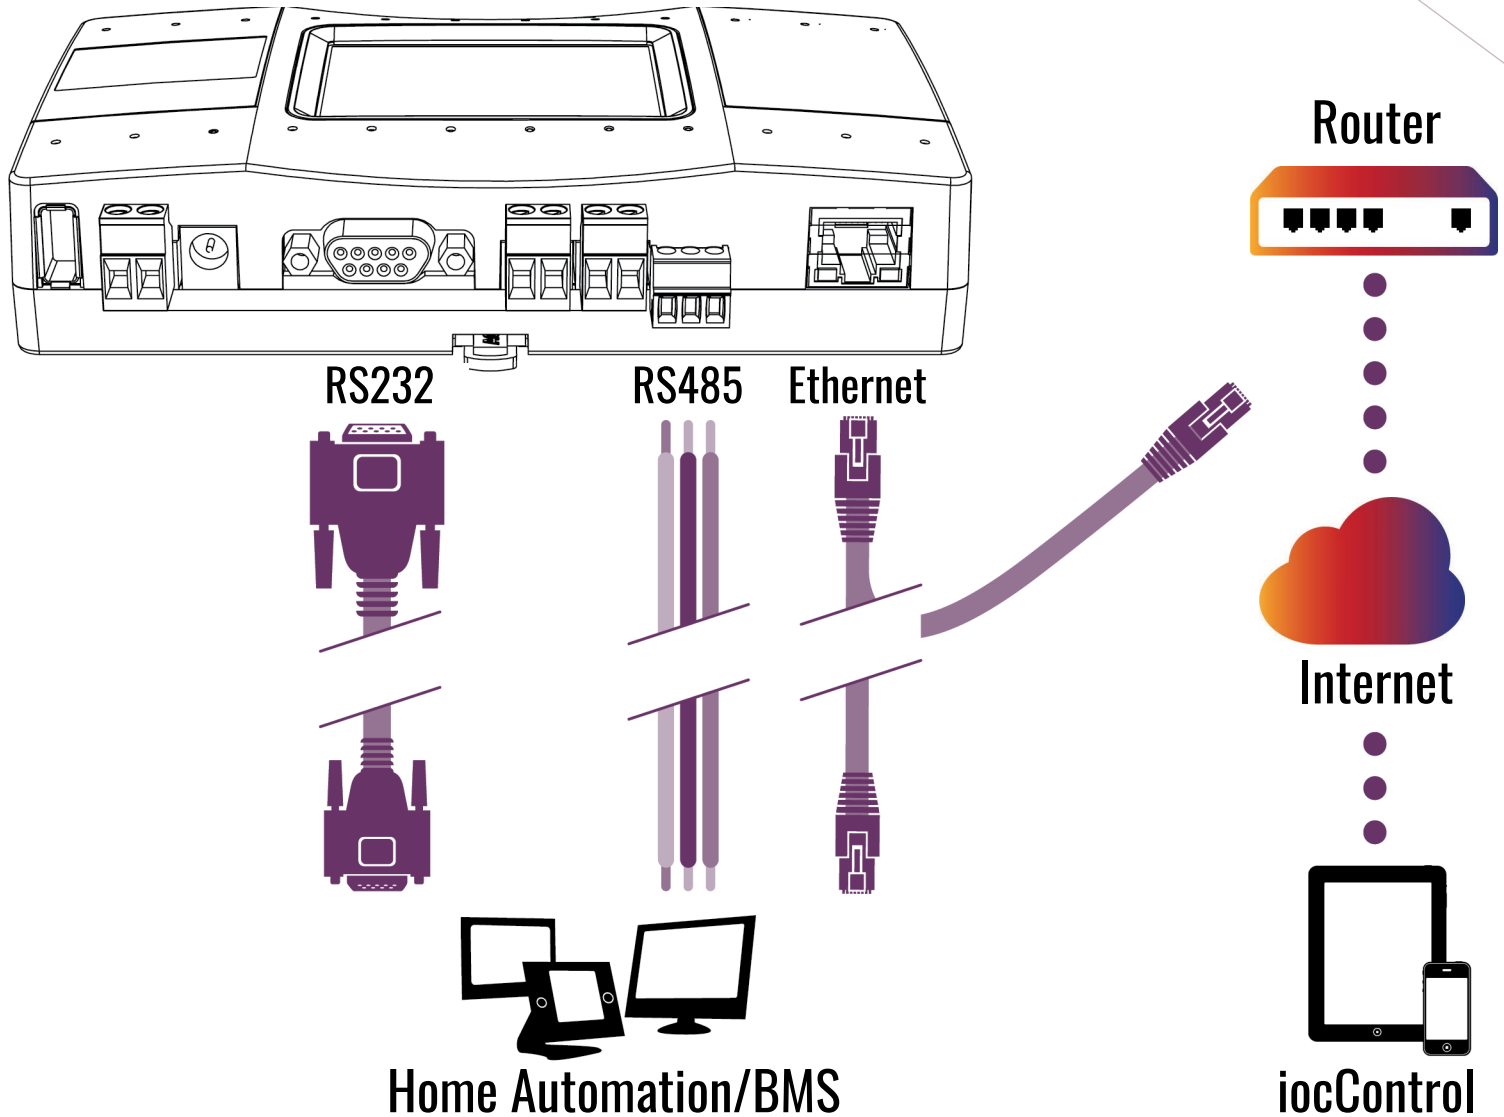

Power Supply


Option A

AC Power supply adapter
(Included in the Box)

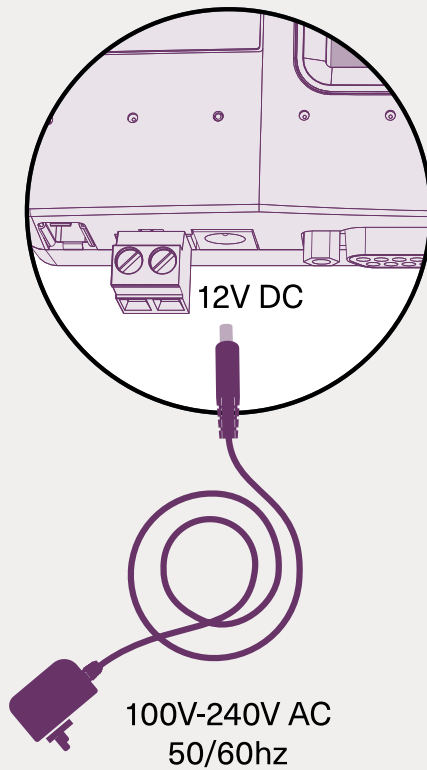


Option B


Direct DC power supply

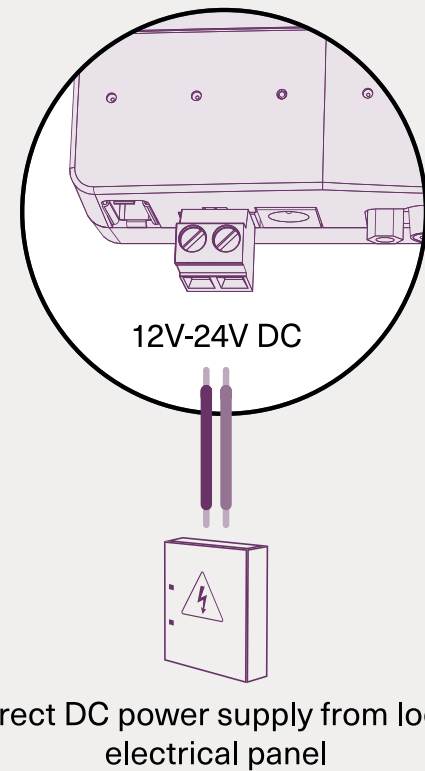

All On/Off operation by external signal

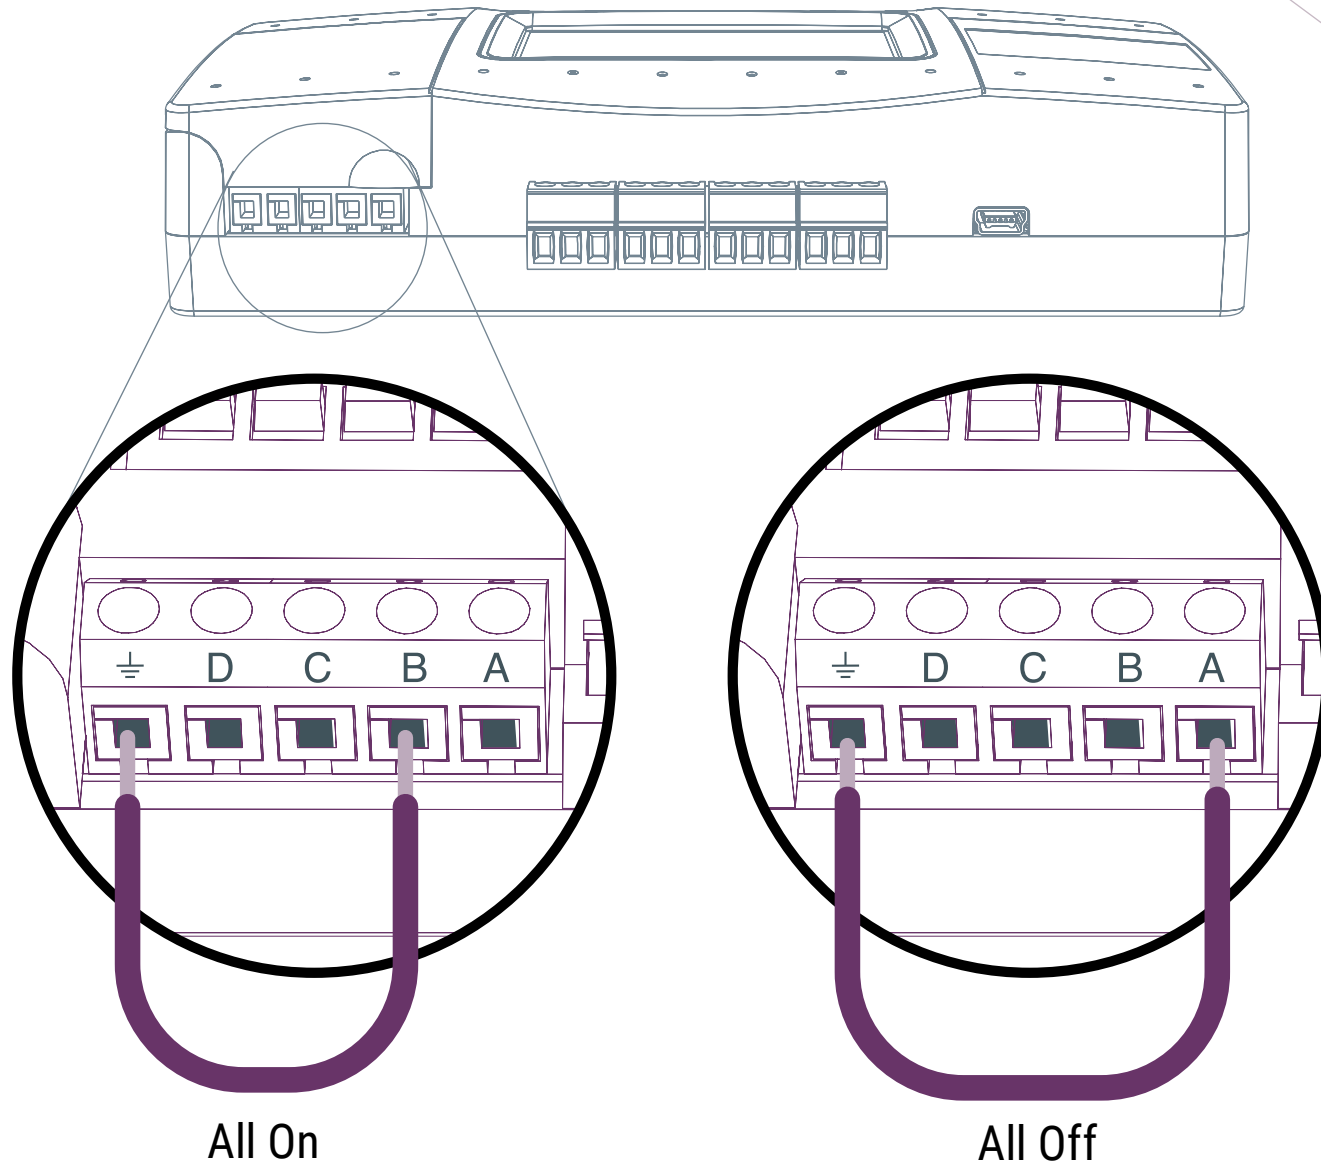


Mounting on a DIN rail

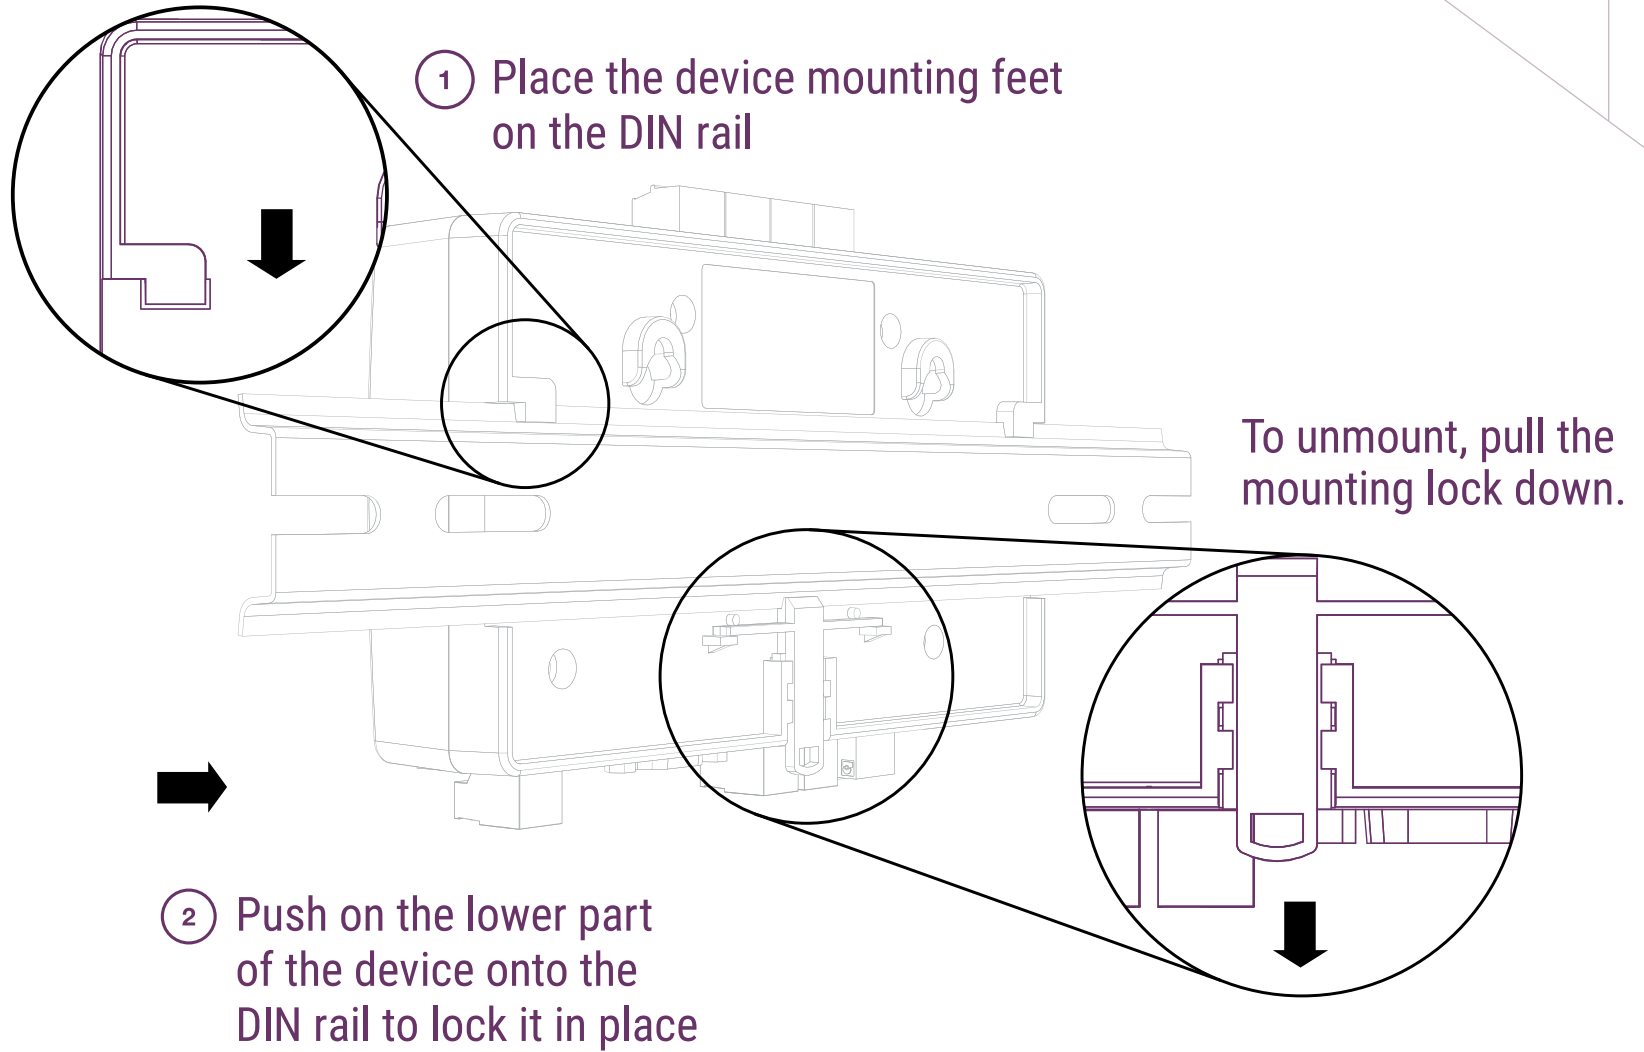


Mounting on a wall

For mounting the CoolMaster device with wall screws, please see attached template with 1:1 dimensions.

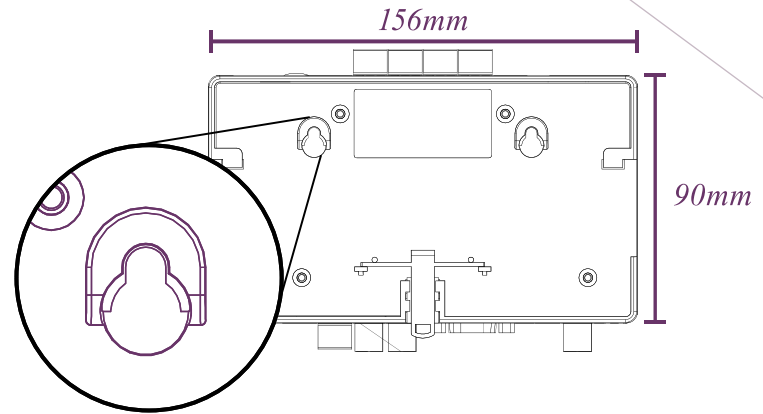


1:1 SCALE MOUNTING TEMPLATE FOR WALL SCREWS

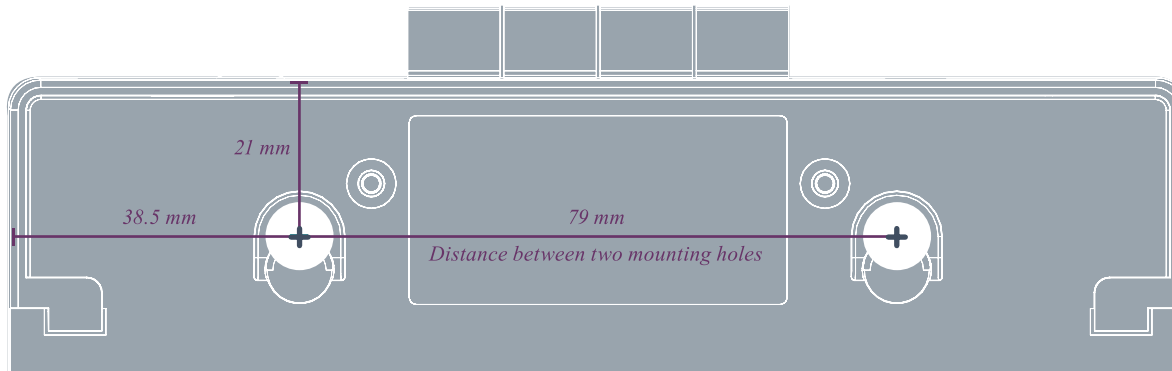

Online Documentation and Support

Scan the QR code (on the box or back of the device) to get to

- Online Documentation
- Registration to the iocControl App
- Support

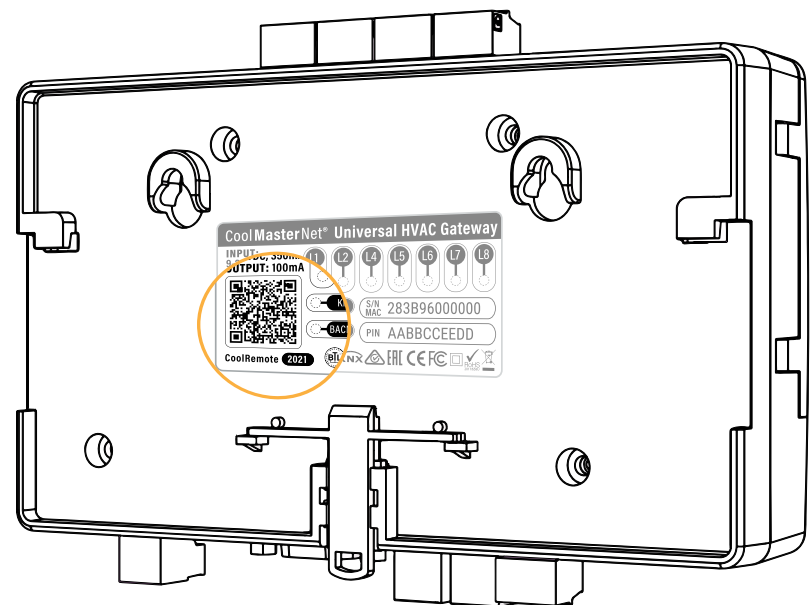

Need more help?

Visit us at: <https://coolautomation.com/support>



COOLAUTOMATION
THE INTERNET OF CLIMATE